



Transient Report

Recording Start Date 01.01.2001 - 0:05:32
Recording Duration 1 (s)
Instrument ID Model 8334 - 1 1:301079 3.0

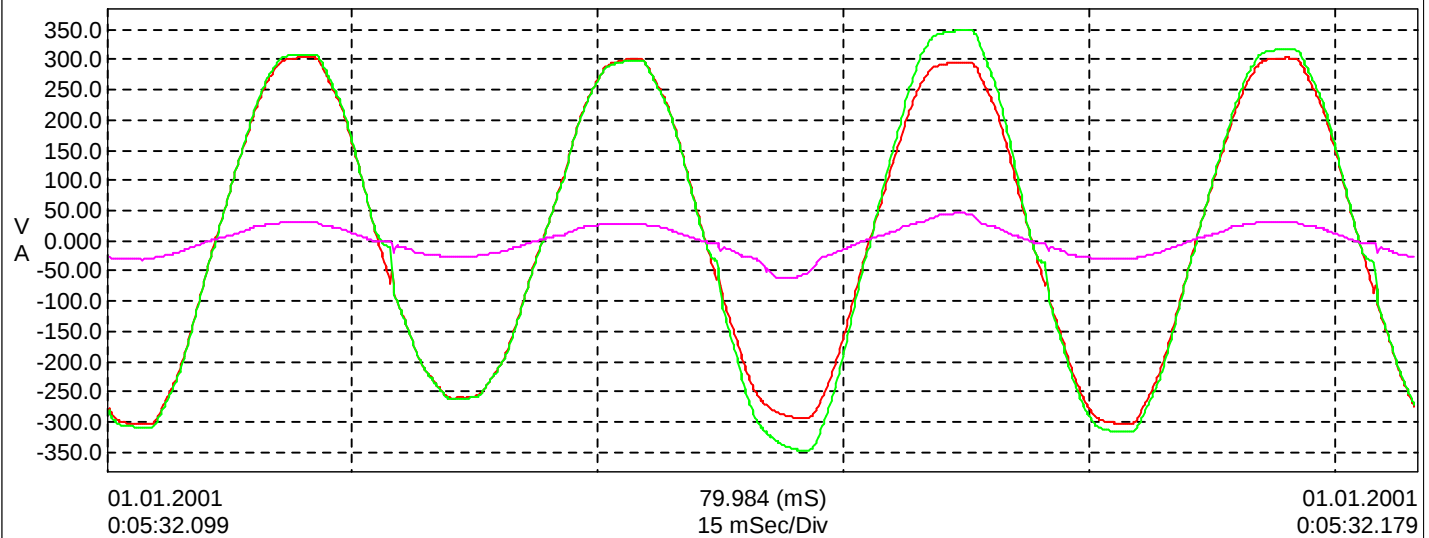

Name	Date	Time	RMS	Units
4Cycles I2	01.01.2001	0:05:32.099	24.528	A
4Cycles V1	01.01.2001	0:05:32.099	217.03	V
4Cycles V2	01.01.2001	0:05:32.099	230.47	V
4Cycles I1	01.01.2001	0:05:32.099	22.831	A

01.01.2001 - 0:05:32.122
Val
-256.0 — 4Cycles V1
-258.0 — 4Cycles V2
-24.00 — 4Cycles I2

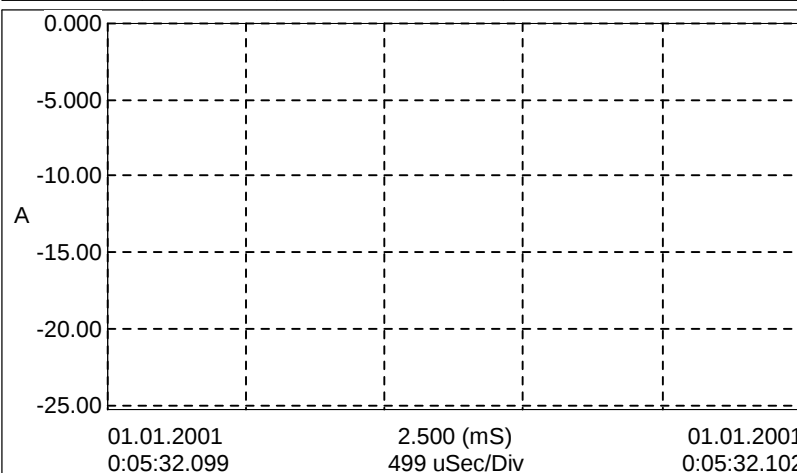


Start Date: 01.01.2001
Start Time: 0:05:32.099
Duration: 79.984 (mS)
Frequency: 50.01 Hz
Magnitude Of Transient: 45.49
Data Point Of Transient: 31.00
VoltageRatio: 1.000000
CurrentRatio: 1.000000
Threshold V: 50 %
Threshold I: 50 %


Name	Date	Time	Duration	Units
Transient Trigger I2	01.01.2001	0:05:32.119	2.510	(mS)

01.01.2001 - 0:05:32.099
Val
X.XX — Transient Trigger I2

Channel Name: Waveform V1
Frequency: 50.01 Hz
VoltageRatio: 1.000000

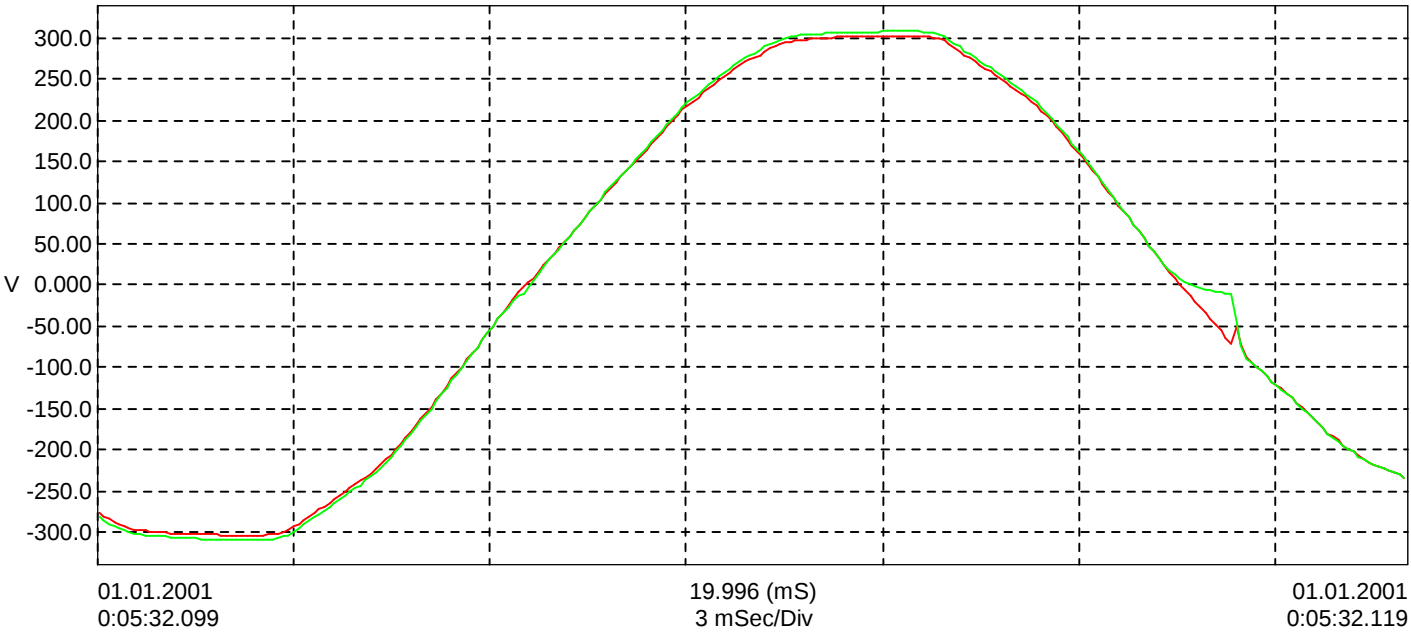

Name	Date	Time	Duration	RMS	Units
Waveform V1	01.01.2001	0:05:32.099	20.006	220.17	V
Waveform V1	01.01.2001	0:05:32.119	20.006	207.30	V
Waveform V1	01.01.2001	0:05:32.139	20.006	218.34	V
Waveform V1	01.01.2001	0:05:32.159	20.006	222.02	V
Waveform V2	01.01.2001	0:05:32.099	20.006	223.61	V
Waveform V2	01.01.2001	0:05:32.119	20.006	210.98	V
Waveform V2	01.01.2001	0:05:32.139	20.006	254.22	V
Waveform V2	01.01.2001	0:05:32.159	20.006	230.93	V

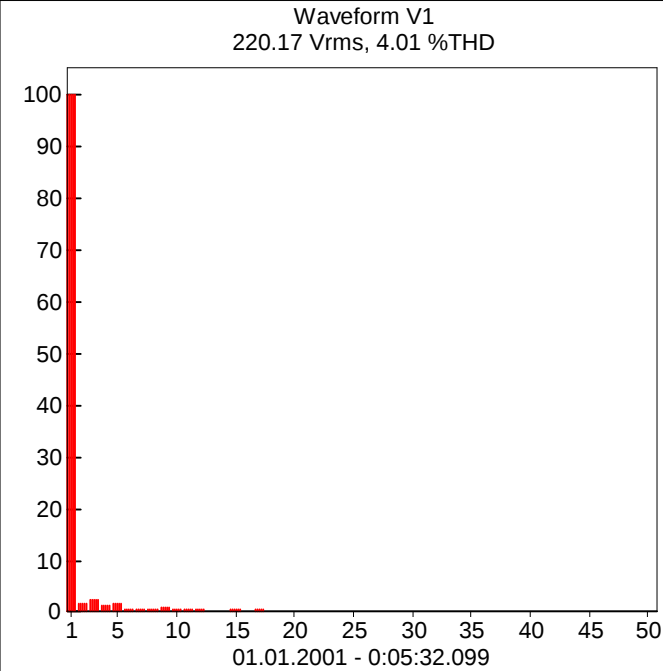

01.01.2001 - 0:05:32.099


Val
-277.0 — Waveform V1
-282.0 — Waveform V2

Waveform V1					
	(%)		(%)		(%)
H01	100.0	H19	0.2	H37	0.1
H02	1.6	H20	0.2	H38	0.1
H03	2.3	H21	0.1	H39	0.1
H04	1.3	H22	0.2	H40	0.2
H05	1.5	H23	0.2	H41	0.1
H06	0.7	H24	0.2	H42	0.2
H07	0.4	H25	0.3	H43	0.1
H08	0.4	H26	0.3	H44	0.0
H09	1.0	H27	0.2	H45	0.1
H10	0.5	H28	0.1	H46	0.1
H11	0.6	H29	0.1	H47	0.1
H12	0.4	H30	0.1	H48	0.2
H13	0.1	H31	0.2	H49	0.2
H14	0.3	H32	0.2	H50	0.1
H15	0.6	H33	0.2		
H16	0.3	H34	0.2		
H17	0.4	H35	0.2		
H18	0.3	H36	0.1		


Channel Name: Waveform I1

Frequency: 50.01 Hz

CurrentRatio: 1.000000

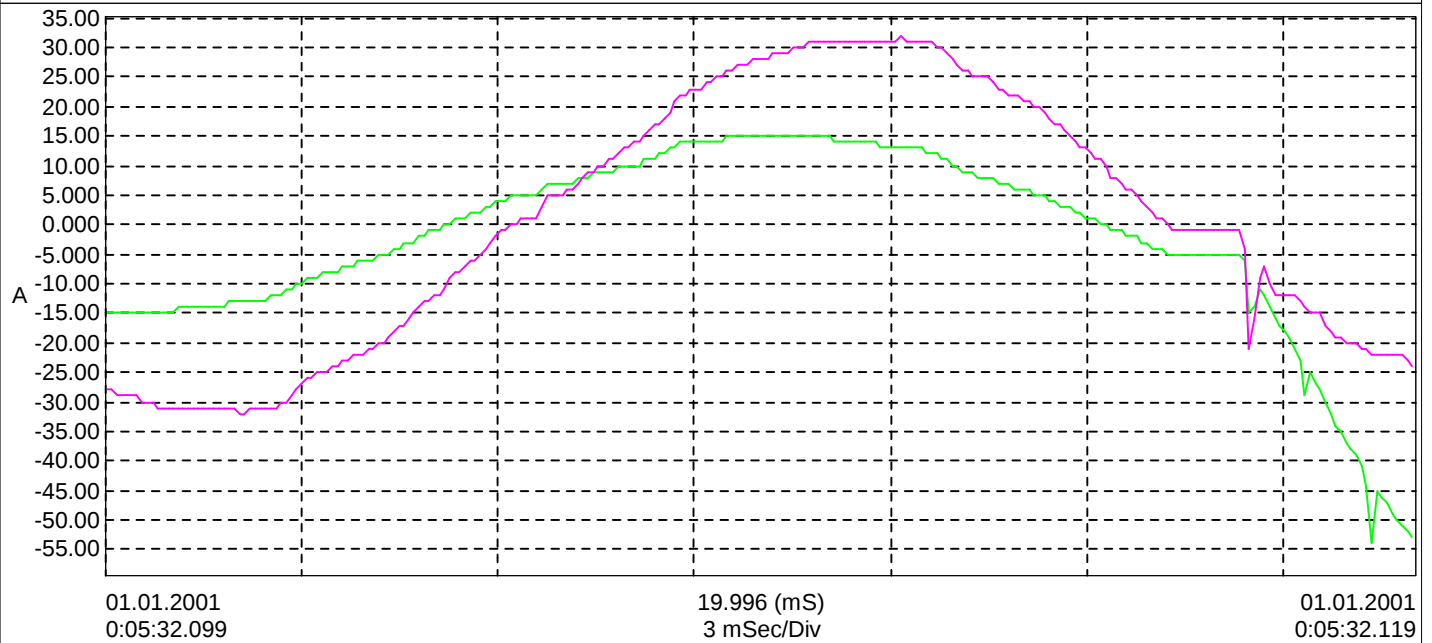

Name	Date	Time	Duration	RMS	Units
Waveform I1	01.01.2001	0:05:32.099	20.006	15.761	A
Waveform I1	01.01.2001	0:05:32.119	20.006	37.868	A
Waveform I1	01.01.2001	0:05:32.139	20.006	17.017	A
Waveform I1	01.01.2001	0:05:32.159	20.006	10.633	A
Waveform I2	01.01.2001	0:05:32.099	20.006	21.621	A
Waveform I2	01.01.2001	0:05:32.119	20.006	20.412	A
Waveform I2	01.01.2001	0:05:32.139	20.006	32.306	A
Waveform I2	01.01.2001	0:05:32.159	20.006	21.879	A

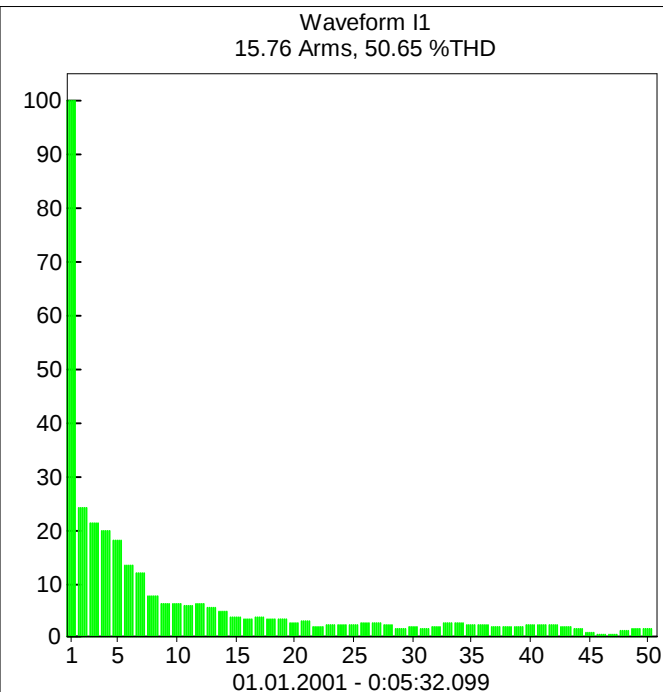

01.01.2001 - 0:05:32.099

Val

-15.00 — Waveform I1
-28.00 — Waveform I2

Waveform I1

	(%)		(%)		(%)
H01	100.0	H19	3.4	H37	2.0
H02	24.1	H20	2.7	H38	2.0
H03	21.4	H21	3.0	H39	2.1
H04	20.0	H22	1.8	H40	2.2
H05	18.2	H23	2.3	H41	2.5
H06	13.6	H24	2.3	H42	2.4
H07	11.8	H25	2.4	H43	1.8
H08	7.7	H26	2.7	H44	1.6
H09	6.4	H27	2.7	H45	1.0
H10	6.4	H28	2.4	H46	0.6
H11	5.8	H29	1.6	H47	0.6
H12	6.4	H30	1.9	H48	1.2
H13	5.7	H31	1.7	H49	1.6
H14	4.7	H32	2.1	H50	1.6
H15	3.8	H33	2.7		
H16	3.5	H34	2.6		
H17	3.6	H35	2.5		
H18	3.5	H36	2.5		

Transient Report

Database: E:\èçìåðåíëÿ\ÇîëÂîð ÑîÏÒî-22\Transient A01.dvb

Operator

Test Site

Comments

