



Transient Report

Recording Start Date 28.04.2010 - 9:59:29
 Recording Duration 1 (s)
 Instrument ID Model 8334 - 1 1:301079 3.0

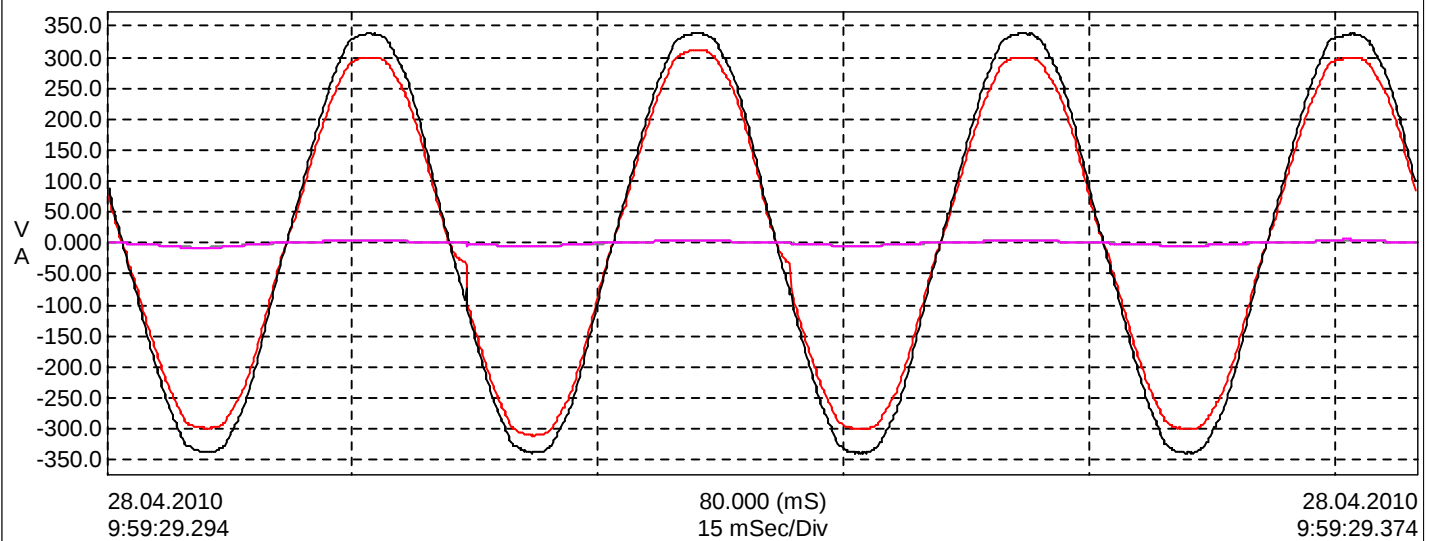

Name	Date	Time	RMS	Units
4Cycles V2	28.04.2010	9:59:29.294	217.86	V
4Cycles V1	28.04.2010	9:59:29.294	243.89	V
4Cycles I1	28.04.2010	9:59:29.294	3.2479	A
4Cycles I2	28.04.2010	9:59:29.294	3.4752	A

28.04.2010 - 9:59:29.316
 Val
 -28.00 — 4Cycles V2
 -68.00 — 4Cycles V1
 -86.00m — 4Cycles I1
 -0.367 — 4Cycles I2

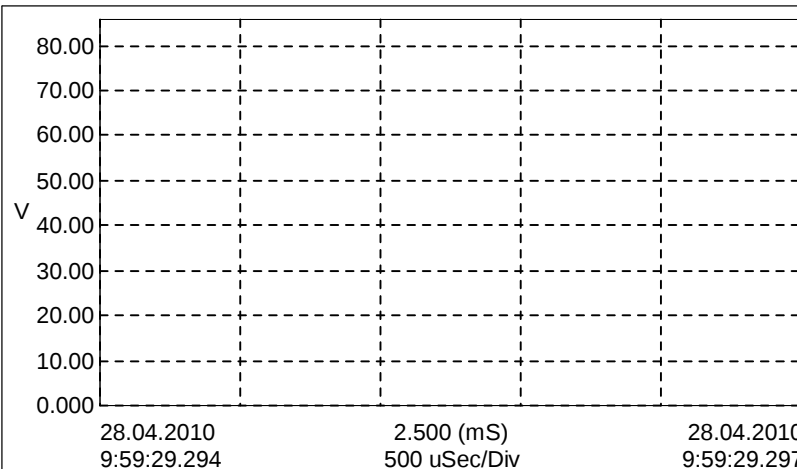

Start Date: 28.04.2010
 Start Time: 9:59:29.294
 Duration: 80.000 (mS)
 Frequency: 50.00 Hz
 Magnitude Of Transient: -5.017
 Data Point Of Transient: 25.00
 VoltageRatio: 1.000000
 CurrentRatio: 1.000000
 Threshold V: 10 %
 Threshold I: 100 %


Name	Date	Time	Duration	Units
Transient Trigger V2	28.04.2010	9:59:29.314	2.510	(mS)

28.04.2010 - 9:59:29.294
 Val
 X.XX — Transient Trigger V2


Channel Name: Waveform V1

Frequency: 50.00 Hz

VoltageRatio: 1.000000

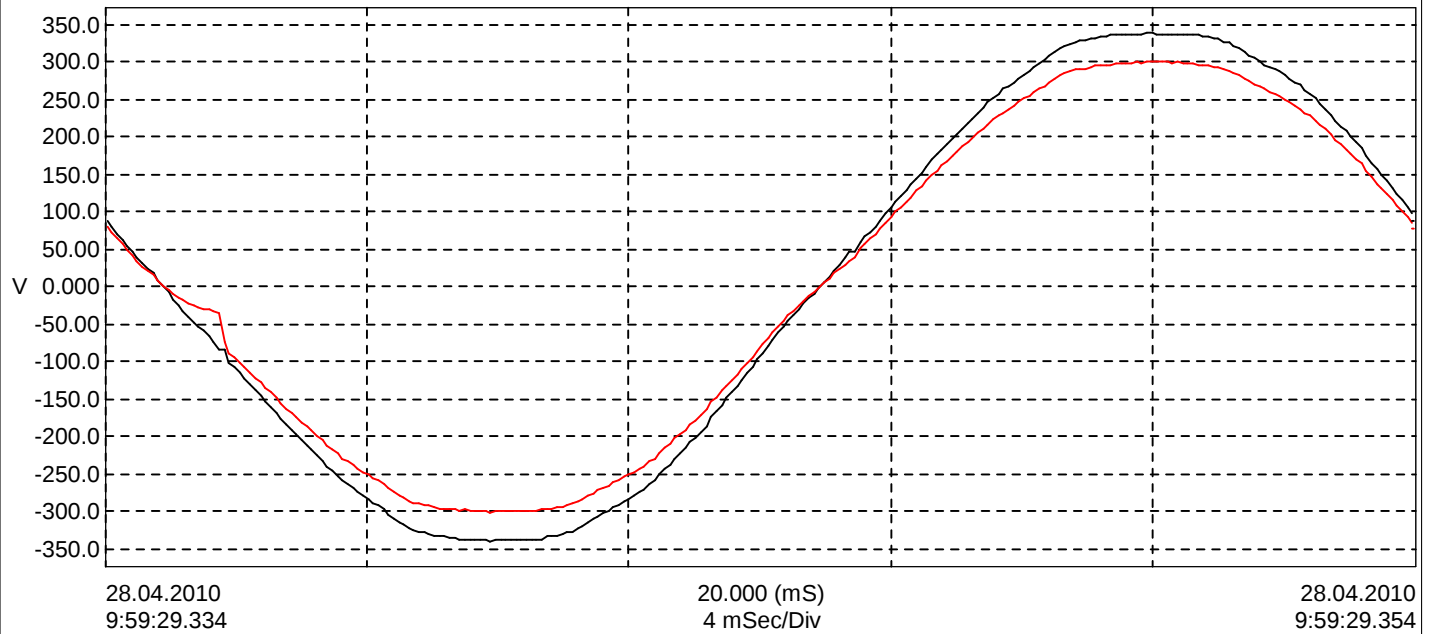

Name	Date	Time	Duration	RMS	Units
Waveform V1	28.04.2010	9:59:29.294	20.010	243.38	V
Waveform V1	28.04.2010	9:59:29.314	20.010	243.85	V
Waveform V1	28.04.2010	9:59:29.334	20.010	244.21	V
Waveform V1	28.04.2010	9:59:29.354	20.010	244.13	V
Waveform V2	28.04.2010	9:59:29.294	20.010	215.43	V
Waveform V2	28.04.2010	9:59:29.314	20.010	223.68	V
Waveform V2	28.04.2010	9:59:29.334	20.010	216.07	V
Waveform V2	28.04.2010	9:59:29.354	20.010	216.14	V

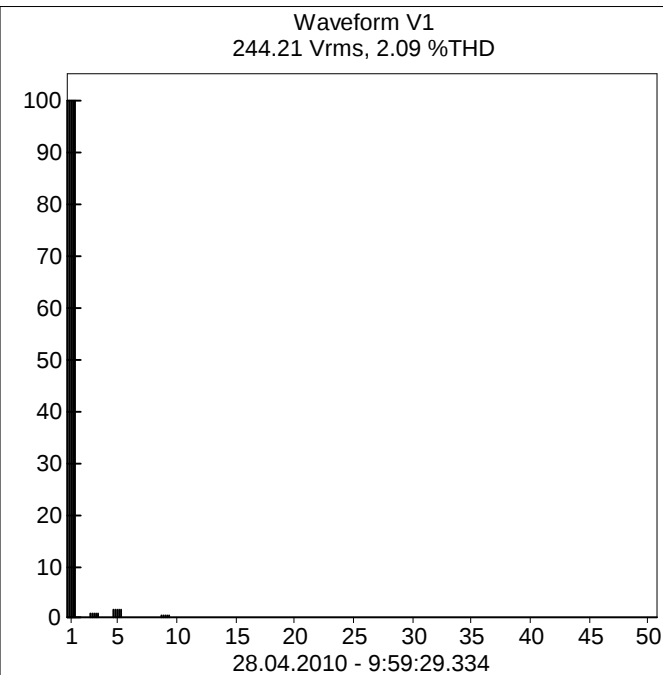

28.04.2010 - 9:59:29.334

Val

89.00 — Waveform V1
81.00 — Waveform V2


Waveform V1

(%)	(%)	(%)
H01 100.0	H19 0.1	H37 0.0
H02 0.0	H20 0.0	H38 0.0
H03 0.9	H21 0.1	H39 0.0
H04 0.1	H22 0.0	H40 0.0
H05 1.7	H23 0.2	H41 0.0
H06 0.1	H24 0.0	H42 0.0
H07 0.1	H25 0.1	H43 0.0
H08 0.0	H26 0.0	H44 0.0
H09 0.5	H27 0.0	H45 0.0
H10 0.0	H28 0.0	H46 0.0
H11 0.3	H29 0.0	H47 0.0
H12 0.0	H30 0.0	H48 0.0
H13 0.1	H31 0.1	H49 0.0
H14 0.0	H32 0.0	H50 0.0
H15 0.1	H33 0.1	
H16 0.1	H34 0.0	
H17 0.2	H35 0.0	
H18 0.0	H36 0.0	


Channel Name: Waveform I1

Frequency: 50.00 Hz

CurrentRatio: 1.000000

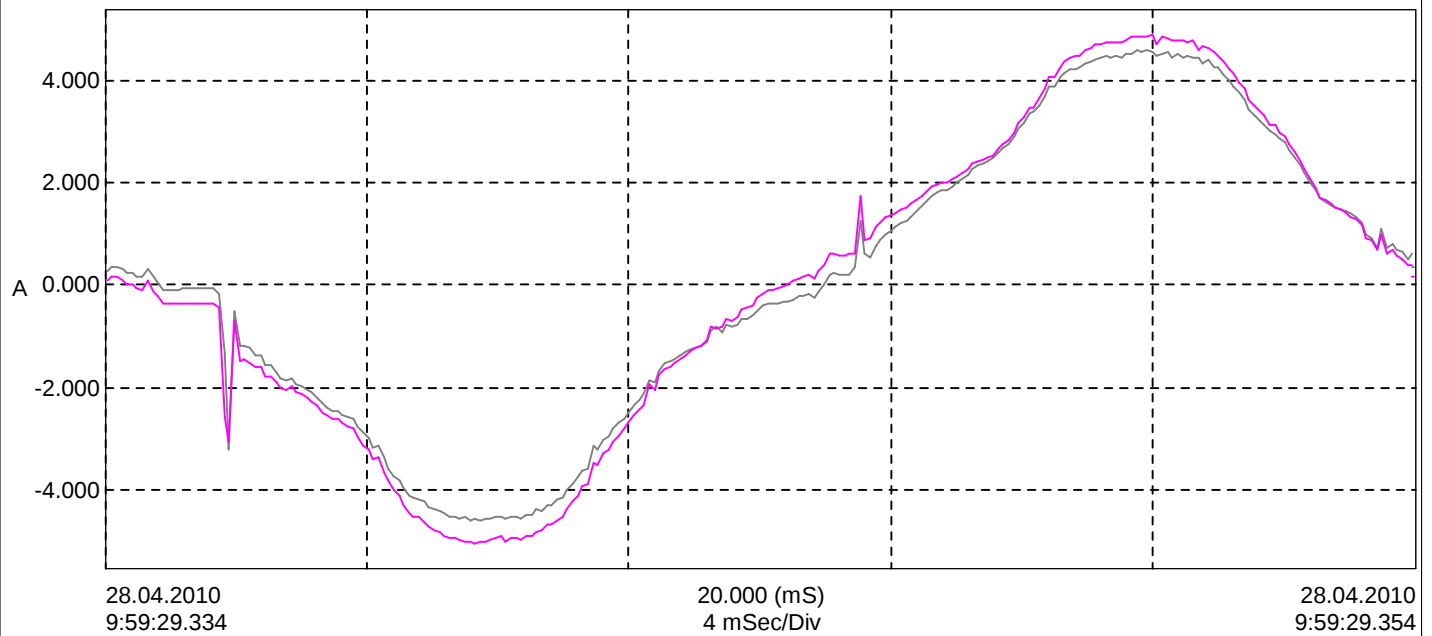

Name	Date	Time	Duration	RMS	Units
Waveform I1	28.04.2010	9:59:29.294	20.010	3.8302	A
Waveform I1	28.04.2010	9:59:29.314	20.010	3.3959	A
Waveform I1	28.04.2010	9:59:29.334	20.010	2.8358	A
Waveform I1	28.04.2010	9:59:29.354	20.010	2.8199	A
Waveform I2	28.04.2010	9:59:29.294	20.010	4.1647	A
Waveform I2	28.04.2010	9:59:29.314	20.010	3.5444	A
Waveform I2	28.04.2010	9:59:29.334	20.010	3.0446	A
Waveform I2	28.04.2010	9:59:29.354	20.010	3.0219	A

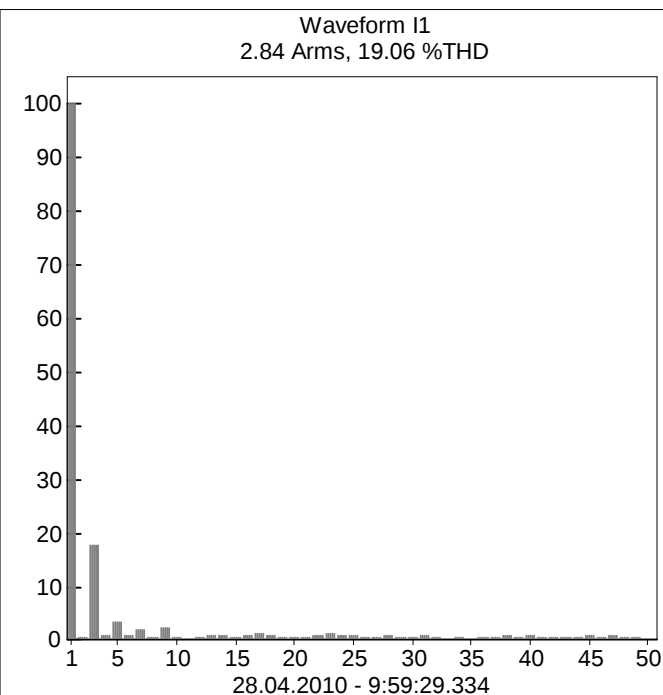

28.04.2010 - 9:59:29.334

Val

0.291 — Waveform I1

86.00m — Waveform I2

Waveform I1

	(%)		(%)		(%)
H01	100.0	H19	0.4	H37	0.6
H02	0.6	H20	0.5	H38	0.8
H03	17.8	H21	0.4	H39	0.6
H04	0.9	H22	0.8	H40	0.8
H05	3.5	H23	1.3	H41	0.6
H06	1.0	H24	0.9	H42	0.7
H07	2.1	H25	0.9	H43	0.6
H08	0.6	H26	0.7	H44	0.6
H09	2.5	H27	0.5	H45	0.8
H10	0.4	H28	0.7	H46	0.5
H11	0.2	H29	0.7	H47	0.9
H12	0.7	H30	0.6	H48	0.5
H13	0.8	H31	0.8	H49	0.7
H14	0.8	H32	0.6	H50	0.3
H15	0.5	H33	0.2		
H16	0.7	H34	0.6		
H17	1.1	H35	0.2		
H18	0.9	H36	0.7		

Transient Report

Database: E:\èçìåðåíëÿ\Ðîæíû\1é ñòàáèèèçàòîð\Transient 9999929.dvb

Operator

Test Site

Comments

