



Transient Report

Recording Start Date 11.08.2011 - 13:56:58
 Recording Duration 1 (s)
 Instrument ID Model 8334 - 1 1:301079 3.0

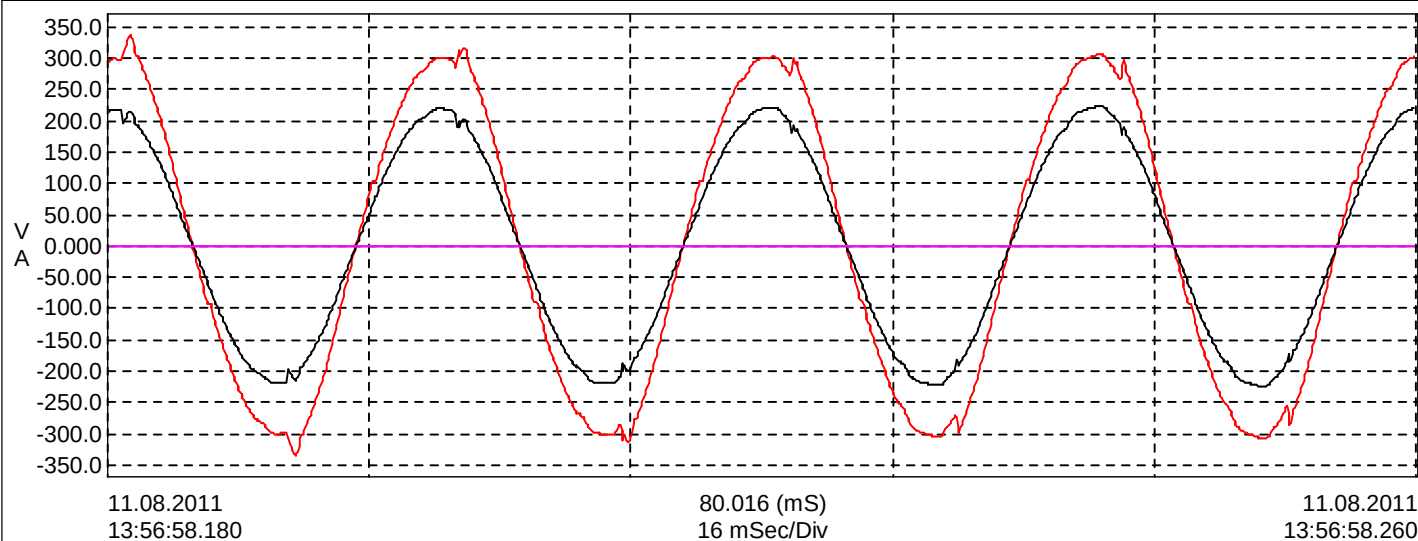

Name	Date	Time	RMS	Units
4Cycles V2	11.08.2011	13:56:58.180	222.22	V
4Cycles V1	11.08.2011	13:56:58.180	156.11	V
4Cycles I1	11.08.2011	13:56:58.180	26.775	m A
4Cycles I2	11.08.2011	13:56:58.180	40.724	m A

11.08.2011 - 13:56:58.180
 Val
 295.0 — 4Cycles V2
 215.0 — 4Cycles V1
 22.00m — 4Cycles I1
 32.00m — 4Cycles I2

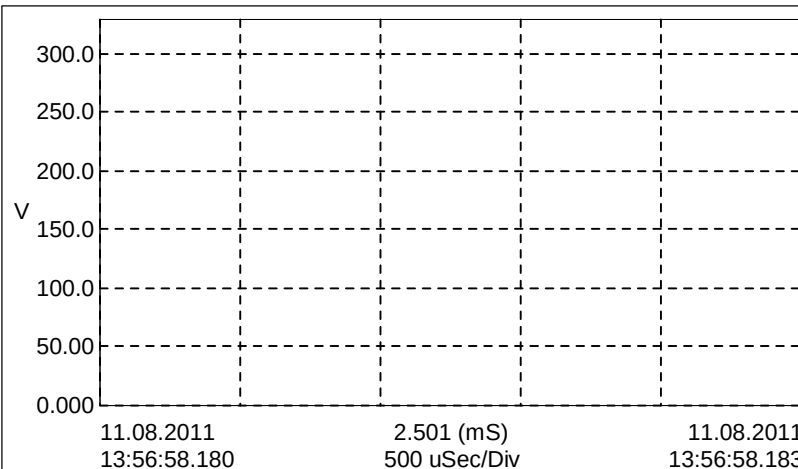

Start Date: 11.08.2011
 Start Time: 13:56:58.180
 Duration: 80.016 (mS)
 Frequency: 49.99 Hz
 Magnitude Of Transient: -24.44
 Data Point Of Transient: 17.00
 VoltageRatio: 1.000000
 CurrentRatio: 1.000000
 Threshold V: 10 %
 Threshold I: 1 %


Name	Date	Time	Duration	Units
Transient Trigger V2	11.08.2011	13:56:58.200	2.511	(mS)

11.08.2011 - 13:56:58.180
 Val
 X.XX — Transient Trigger V2

Channel Name: Waveform V2

Frequency: 49.99 Hz

VoltageRatio: 1.000000

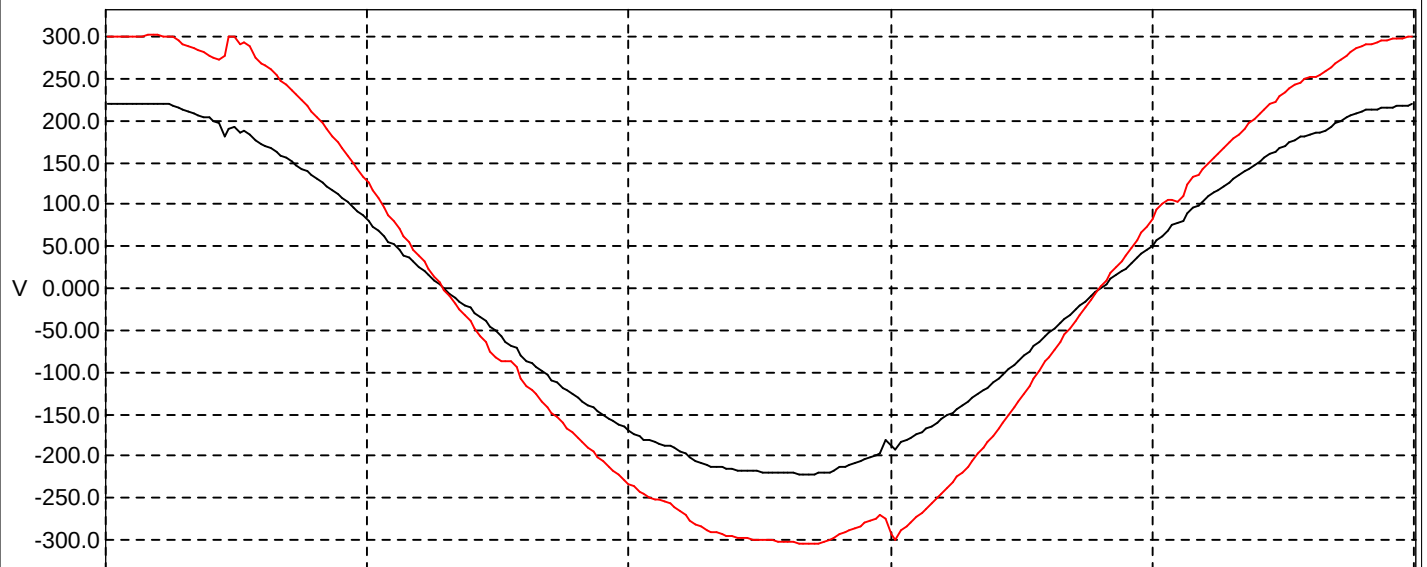


11.08.2011
13:56:58.220

20.004 (mS)
4 mSec/Div

11.08.2011
13:56:58.240

Name	Date	Time	Duration	RMS	Units
Waveform V1	11.08.2011	13:56:58.180	20.014	154.31	V
Waveform V1	11.08.2011	13:56:58.200	20.014	155.43	V
Waveform V1	11.08.2011	13:56:58.220	20.014	156.69	V
Waveform V1	11.08.2011	13:56:58.240	20.014	157.99	V
Waveform V2	11.08.2011	13:56:58.180	20.014	223.21	V
Waveform V2	11.08.2011	13:56:58.200	20.014	222.13	V
Waveform V2	11.08.2011	13:56:58.220	20.014	221.39	V
Waveform V2	11.08.2011	13:56:58.240	20.014	222.14	V

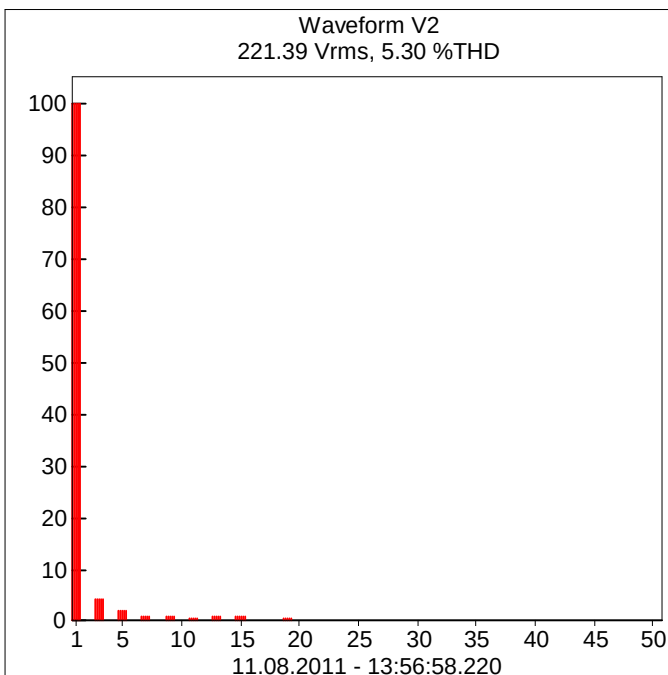

11.08.2011 - 13:56:58.220



Val

219.0 — Waveform V1
300.0 — Waveform V2

Waveform V2

	(%)		(%)		(%)
H01	100.0	H19	0.6	H37	0.3
H02	0.2	H20	0.2	H38	0.2
H03	4.4	H21	0.3	H39	0.2
H04	0.1	H22	0.1	H40	0.0
H05	2.1	H23	0.4	H41	0.2
H06	0.2	H24	0.2	H42	0.2
H07	0.7	H25	0.3	H43	0.2
H08	0.1	H26	0.0	H44	0.0
H09	0.7	H27	0.3	H45	0.1
H10	0.2	H28	0.2	H46	0.2
H11	0.4	H29	0.2	H47	0.1
H12	0.0	H30	0.1	H48	0.1
H13	1.0	H31	0.2	H49	0.1
H14	0.2	H32	0.2	H50	0.1
H15	0.8	H33	0.3		
H16	0.1	H34	0.1		
H17	0.3	H35	0.1		
H18	0.1	H36	0.1		

CurrentRatio: 1.000000

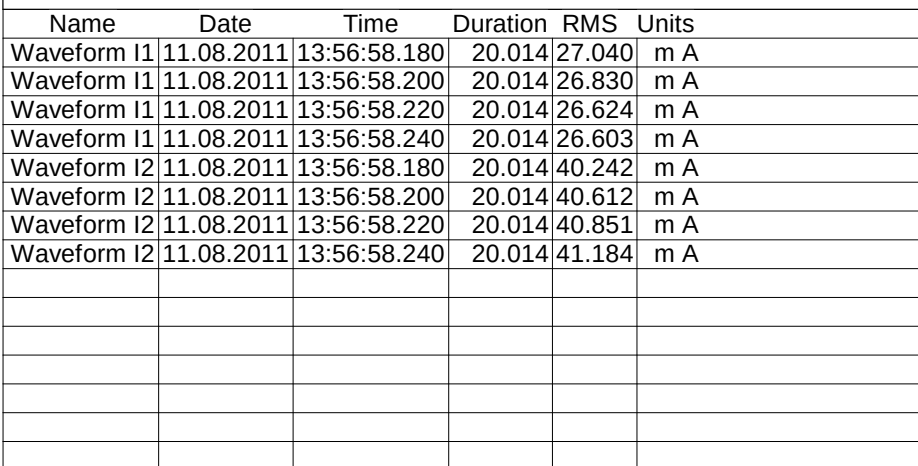

Waveform I1					
	(%)		(%)		(%)
H01	100.0	H19	11.5	H37	2.4
H02	0.6	H20	2.0	H38	1.2
H03	7.5	H21	0.8	H39	0.7
H04	0.3	H22	2.0	H40	0.9
H05	4.1	H23	1.3	H41	3.2
H06	0.7	H24	1.2	H42	2.0
H07	2.0	H25	1.3	H43	1.2
H08	0.2	H26	0.7	H44	1.8
H09	2.2	H27	2.3	H45	2.9
H10	0.3	H28	0.6	H46	0.6
H11	1.4	H29	1.4	H47	1.3
H12	1.2	H30	1.5	H48	0.3
H13	0.9	H31	2.6	H49	1.5
H14	1.4	H32	1.6	H50	1.2
H15	1.8	H33	1.7		
H16	0.8	H34	1.7		
H17	1.1	H35	1.1		
H18	2.4	H36	1.2		

Transient Report

Database: E:\èçlâöâîëÿ\Donstab-NEW\Transient AA06.dvb

Operator

Test Site

Comments

